

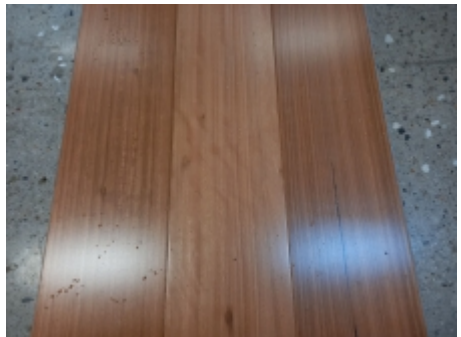
Golden Elite Group - Light Brown, Australian Species Range, Timber Look Plank, SPT005.006.008 - Wet Sliptest MG070322-14

07 Mar 2022

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	07 Mar 2022
Test Report Number:	MG070322-14
Client Name & Address:	Golden Elite Group - 680 Boundary Road, Richlands 4077
Test Site / Surface Tested :	Light Brown, Australian Species Range, Timber Look Plank, SPT005.006.008, Smooth
Sample Information :	Samples and Test Information Supplied by Client
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Any Variations to Standards	Variation to Standards at Clients request
Testing Officer / Approved Signatory:	Michael Genero
Pendulum in use - Calibration Date :	#SK2072 - Wessex Portable Skid Tester (C : 07.05.21)
Signature of Approved Signatory :	

Test Results :

Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	SCV :	Surface Picture
1A - 0°	26	24	23	22	21	22	N/A	
1B - 45°	26	25	24	24	23	24	N/A	
2A - 90°	23	20	19	18	17	18	N/A	
2B - 180°	22	20	18	17	16	17	N/A	
3A - 270°	25	24	23	23	22	23	N/A	

Reported SRV For Test Area :	21
CLASSIFICATION using Slider 96 (4S Slider)	P1 = 12 - 24

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A - Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results do not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

